

European B1
Fire Rating

soft collection · softwall + softblock
Fire Retardant (FR) Treated textile products

molo design, ltd

1470 Venables Street
Vancouver, B.C.
Canada V5L 2G7

t +1 604 696 2501
f +1 604 685 0342

info@molodesign.com
www.molodesign.com



soft collection textile products European B1 fire rating

molo soft collection textile products are completely fire retardant, and will not maintain a flame. textile softwall + softblock have achieved the European standard B1. This rating is consistent with use in all types of occupancies. All products should always be kept away from any open flame or heat source to avoid possible damage.



Testing. Advising. Assuring.

Test report No. 2015-2229

for applying of a required "Verwendbarkeitsnachweis"
issued 13.01.2016

Applicant: molo design ltd.
1470 Venables St. Vancouver BC, Canada V5L 2G7

Date of order: 23.11.2015
Date of sampling: *no official sampling of the specimen by a representative of Exova Warringtonfire, Frankfurt*
Date of arrival: 30.11.2015
Date of test: 05.01.2016

Order

Testing of the flammability (building class B1) according to DIN 4102-1 (May 1998)

Description / designation of the test object

Material referred to as: "tyvek" or „textile“

Description of the relevant test procedure

DIN 4102 part 1 (Mai 1998)

This test report did not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the "Verwendbarkeitsnachweis".

1. Description of the test material

1.1 Details of the customer:

Material referred to as: "tyvek" or „textile“

Construction:

sheet of tyvek, a paper-like polyethylene,
with fire retardant treatment

Intended end use of product: room divider

1.2 At the specimen preparation by Exova Warringtonfire, Frankfurt determined values:

Paper pattern

Colour:	white
Thickness:	0,15 mm
Square weight:	76,02 g/m ²

Testing after storing 14- days under climatic conditions (23°C / 50 % rel. humidity).

2. Test results

2.1.1 Brandschachtprüfung according to DIN 4102-1

Sample A: Material tested in production direction

Sample B: Material tested crosswise to the production direction

Test results of the Brandschacht tests part 1						
line no.		Measurements test sample				
			A	B	C	D
1	<u>no. test arrangement according to DIN 4102 part 15, table 1</u>		1	1		
2	<u>flame height max. over lower sample edge</u> time ¹⁾	cm	30	30		
		min : s	0:04	0:05		
3	<u>ascertainties on the front side</u> Flaming/glowing time ¹⁾	min : s	0:04	0:04		
4	<u>melting / burning through</u> time ¹⁾	min : s	0:05	0:06		
5	<u>ascertainties on the back side</u> Flaming/glowing time ¹⁾	min : s	not occurred	not occurred		
6		discolouring time ¹⁾	min : s	no	no	
7	<u>burning droplets</u> begin ¹⁾ extent occasional dropping of material constant dropping of material	min : s	not occurred	not occurred		
8						
9						
10	<u>separating from burning sample parts</u> begin ¹⁾ occasional separating parts constant separating parts	min : s	not occurred	not occurred		
11						
12						
13	duration of burning on the sieve tray (max.)	min : s	not occurred	not occurred		
14	<u>influence on the burner flame by dropping of / separating material</u> time ¹⁾	min : s	no	no		
15	<u>earlier end of test</u> end of the fire scenario on the sample ¹⁾ time of a possible resulted test stop ¹⁾	min : s	no	no		
16		min : s				

¹⁾ time from start of test

Test results of the Brandschacht tests part 2						
line no.		Measurements test sample				
			A	B	C	D
17	<u>flaming after end of test</u> duration	min : s	--/--	--/--		
18	number of sample		--/--	--/--		
19	front side of sample	cm	--/--	--/--		
20	backside of sample		--/--	--/--		
21	flame length		--/--	--/--		
22	<u>glowing after end of test</u> duration	min . s	not occured	not occured		
23	number of sample		--/--	--/--		
	place of occurrence		--/--	--/--		
24	lower sample part		--/--	--/--		
25	upper sample part		--/--	--/--		
26	front side of sample		--/--	--/--		
27	backside of sample		--/--	--/--		
28	<u>smoke density</u> < 400 % x min		12	12		
29	> 440 % x min		--/--	--/--		
30	<u>diagram in annex no.</u>		1	1		
31	<u>residual length</u> single results	cm	63 / 63 64 / 63	65 / 64 64 / 65		
32	average of the single results	cm	63	64		
33	photo of the sample on page		5	5		
34	<u>smoke temperature</u> max. of the average results	°C	118	118		
35	time ¹⁾	min : s	9:00	9:53		
36	diagram in annex no.		1	2		

¹⁾ time from start of test

Remarks: Because of the residual length of > 45 cm, the quantity of tests could be reduced, according to DIN 4102-16.
Melting the samples.

2.1.2 Appearance of the specimen after the test:



Sample A



Sample B

2.2.1 Normal flammability test according to DIN 4102-1

Test with edge ignition without deposit
 Flame application on: lower sample edge
 Edge ignition

Length direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	3	3	4	4	3
Max. flame height [mm]	40	40	50	50	40
Time [s]	3	3	4	4	3
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visuell impression)	low smoke production				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

Cross direction

Sample-no.	1	2	3	4	5
Time from start of test					
Ignition point [s]	1	1	1	1	1
Reaching the measuring mark within 20 seconds	no	no	no	no	no
Self-extinguishing of the flame [s]	4	4	3	3	4
Max. flame height [mm]	50	50	40	40	50
Time [s]	4	4	3	3	4
End of afterflaming [s]	-	-	-	-	-
End of afterglowing [s]	-	-	-	-	-
Flames extinguished after [s]	-	-	-	-	-
Smoke development (visuell impression)	low smoke production				
Separating from burning material	no	no	no	no	no
Time [s]	-	-	-	-	-

Remarks: none

Appearance of the sample after the small burner test:



Assessment

The material, described in chapter one fulfils the requirements of the building class B2 according to DIN 4102-1 (Mai 1998).

The determined test results show that the material also fulfils the requirements

of the building class B1

according to DIN 4102-1 (Mai 1998).

Special comment

The fire test result is only valid for the in chapter one described material in the tested colour and square weight.

The test was carried out in free hanging configuration.

The distance to other plane material must be more or equal then 40 mm.

The material wasn't tested after an outside storage.

In combination with other materials (for example coatings, deposits) the burning behaviour could be influenced unfavourable so that the classification above is not valid any longer. According to DIN 4102-1 the burning behaviour in combination with other materials has to be tested separately.

This test report did not replace the required „Verwendbarkeitsnachweis“. It is only used for issuing the “Verwendbarkeitsnachweis”.

Frankfurt, the 13.01.2016

A handwritten signature in blue ink that reads "Anders".

H. Anders
Tester in Charge

A handwritten signature in blue ink that reads "Zachäus".

Dipl.-Ing. T. Zachäus
Laboratory supervisor

This Test report is valid until 04.01.2021

The results of the tests relate only to the behaviour of the test specimen which is designated on the top.

Test reports are only allowed to be published or reproduced, not changed in form and tenor without permission of the Exova Warringtonfire, Frankfurt. The abridged account of a test report is only allowed with the agreement of the Exova Warringtonfire, Frankfurt.



This test report is a translation of the German version 2015-2229 (issued 13.01.2016). In case of doubt only the German version is valid

This test report contains 8 pages and 2 annex.

Testing. Advising. Assuring.

Annex 1 to the Test report No. 2015-2229 issued 13.01.2016

Sample A:

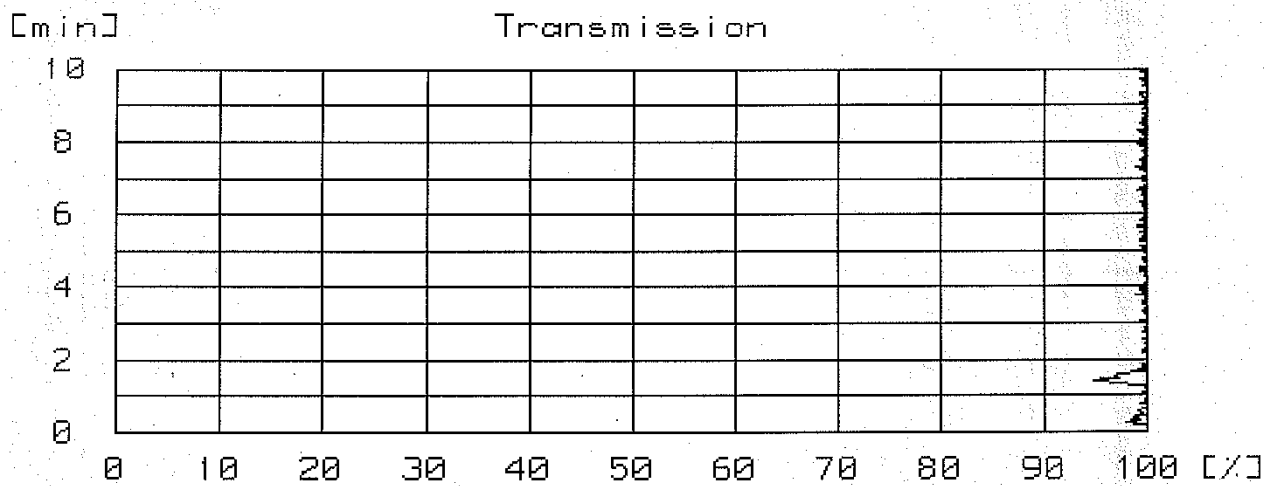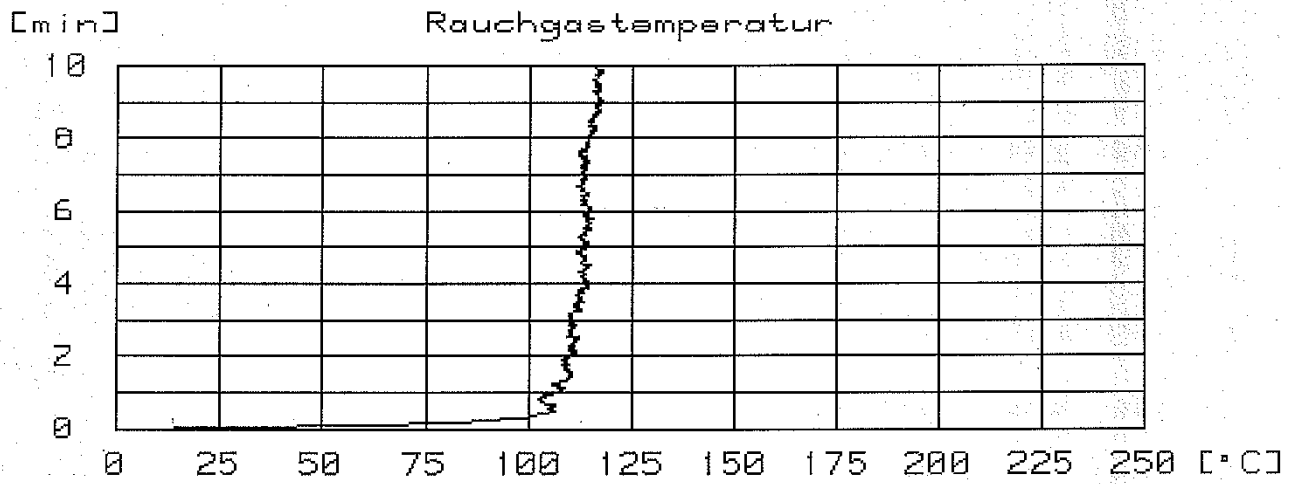

Sample B:

